


NOTE:  
THE CONTRACTOR IS TO  
CHECK PLANS OF THE  
PROJECT FOR THE CORRECT  
NUMBER AND LOCATION OF  
CONDUIT OPENINGS IN  
EACH PULLBOX

NOTE:  
MIN. SIZE OPENING FOR  
REQUIRED CONDUITS TO BE  
CONSTRUCTED BY APPROVED METHOD


NON-METALLIC  
SLEEVES

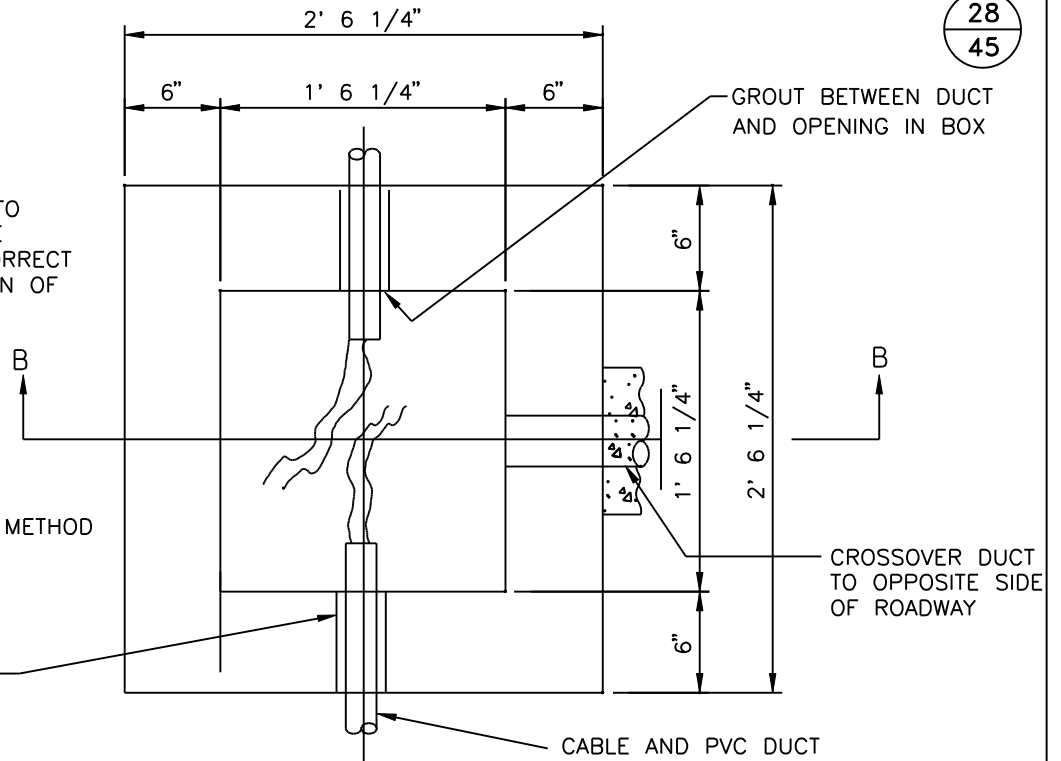

PLAN  
(COVER NOT SHOWN)

NOTE:  
A PROTECTIVE COATING IS REQUIRED  
ON CAST IRON FRAME AND COVER

1/2" PREFORMED EXPANSION  
EXPANSION MATERIAL  
IN SIDEWALK

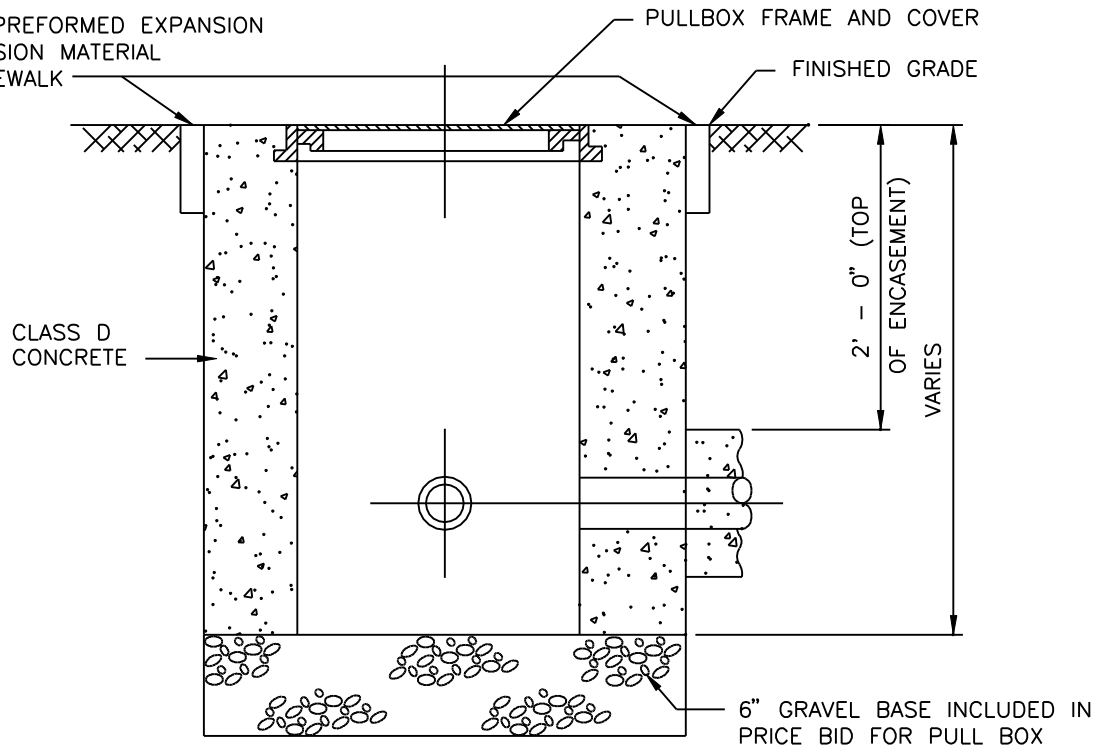

NOTE:  
ALL CONDUITS SHALL ENTER BOX  
WITHOUT 90 DEGREE ELBOW

SECTION B-B

PRECAST PULLBOX

REVISIONS

STANDARDS FOR  
STREET LIGHTING

PULLBOX DETAIL

CITY OF DAYTON, OHIO  
NO SCALE 14A-17113